




- NOTES:
1. REFER TO B.O.M. ON SCHEMATIC DRAWING FOR COMPLETE PARTS DESCRIPTION AND MFG. AND MODEL NO.
 2. PANEL SHALL MEET APPLICABLE NFPA REQUIREMENTS.
 3. REFER TO SEWER PANEL 3M FOR TERMINAL CONNECTIONS.
 4. CUT BARRIER HEIGHT TO FIT IN ENCLOSURE.
 5. DO NOT INSTALL BARRIER UNTIL SUBPANEL IS MOUNTED IN ENCLOSURE. MOUNT SO THAT BOTTOM OF BARRIER IS FLUSH WITH BOTTOM ENCLOSURE.

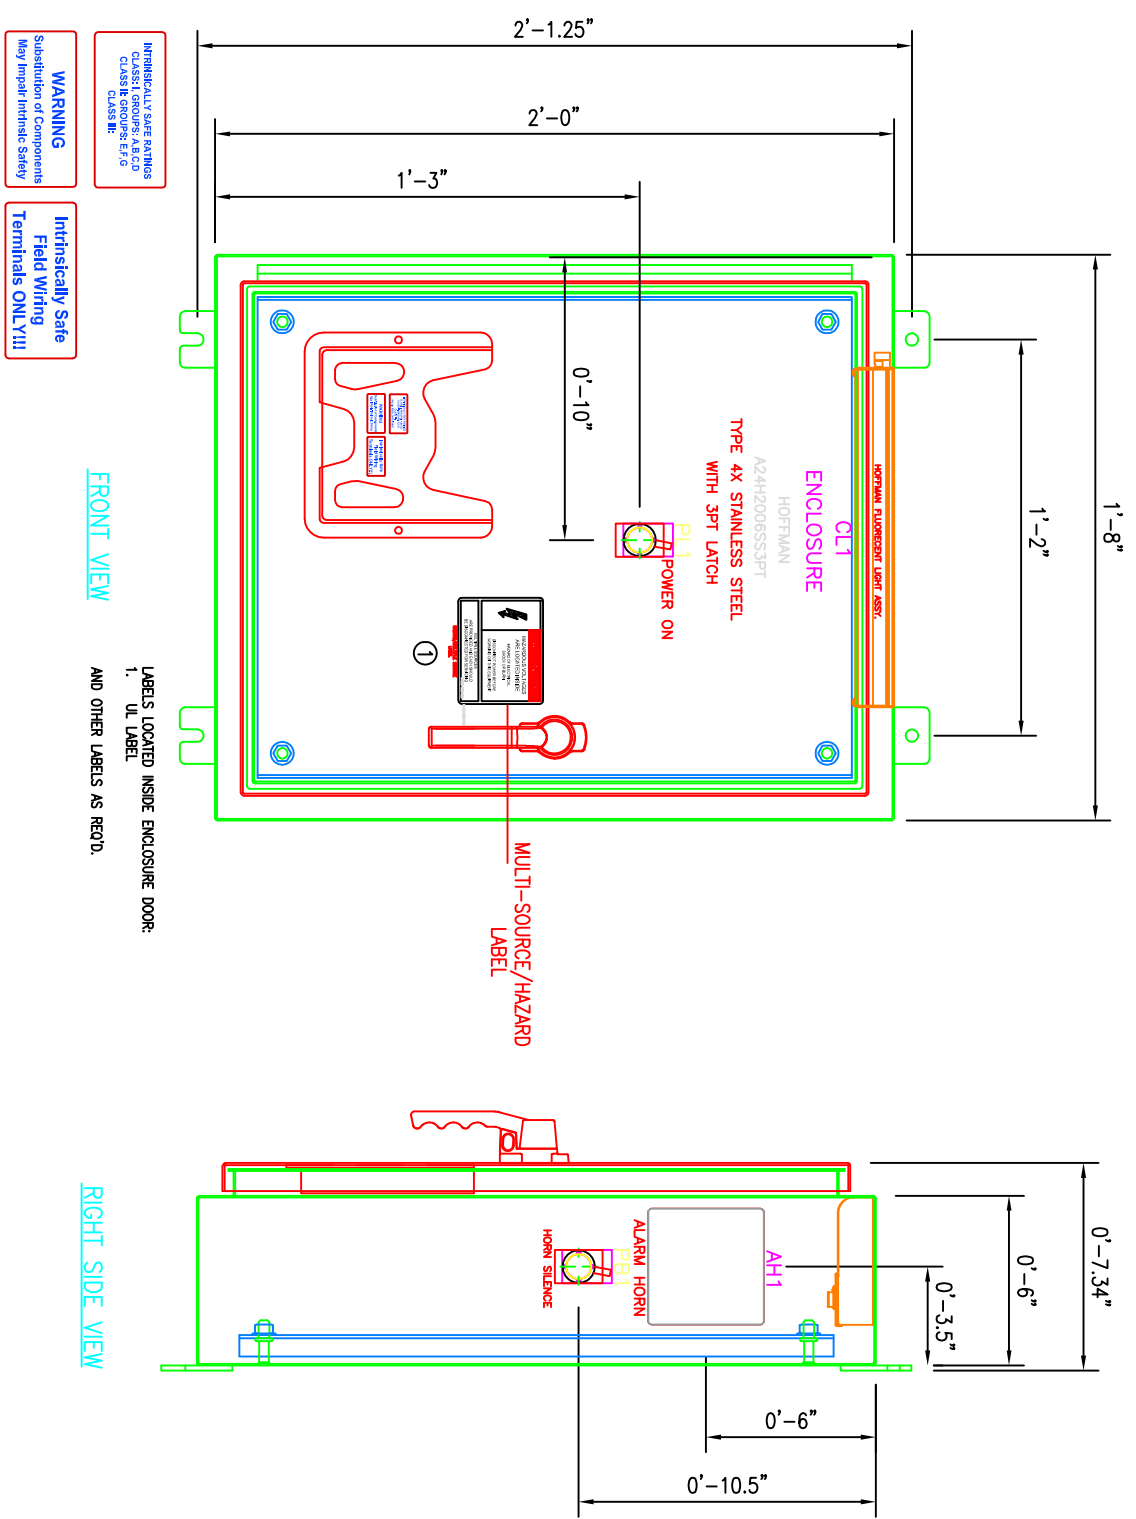


FRONT VIEW

RIGHT SIDE VIEW

LABELS LOCATED INSIDE ENCLOSURE DOOR:
1. UL LABEL
AND OTHER LABELS AS REQ'D.



Intrinsically Safe Field Wiring Terminals ONLY!!!
WARNING
Substitution of Components May Impair Intrinsic Safety

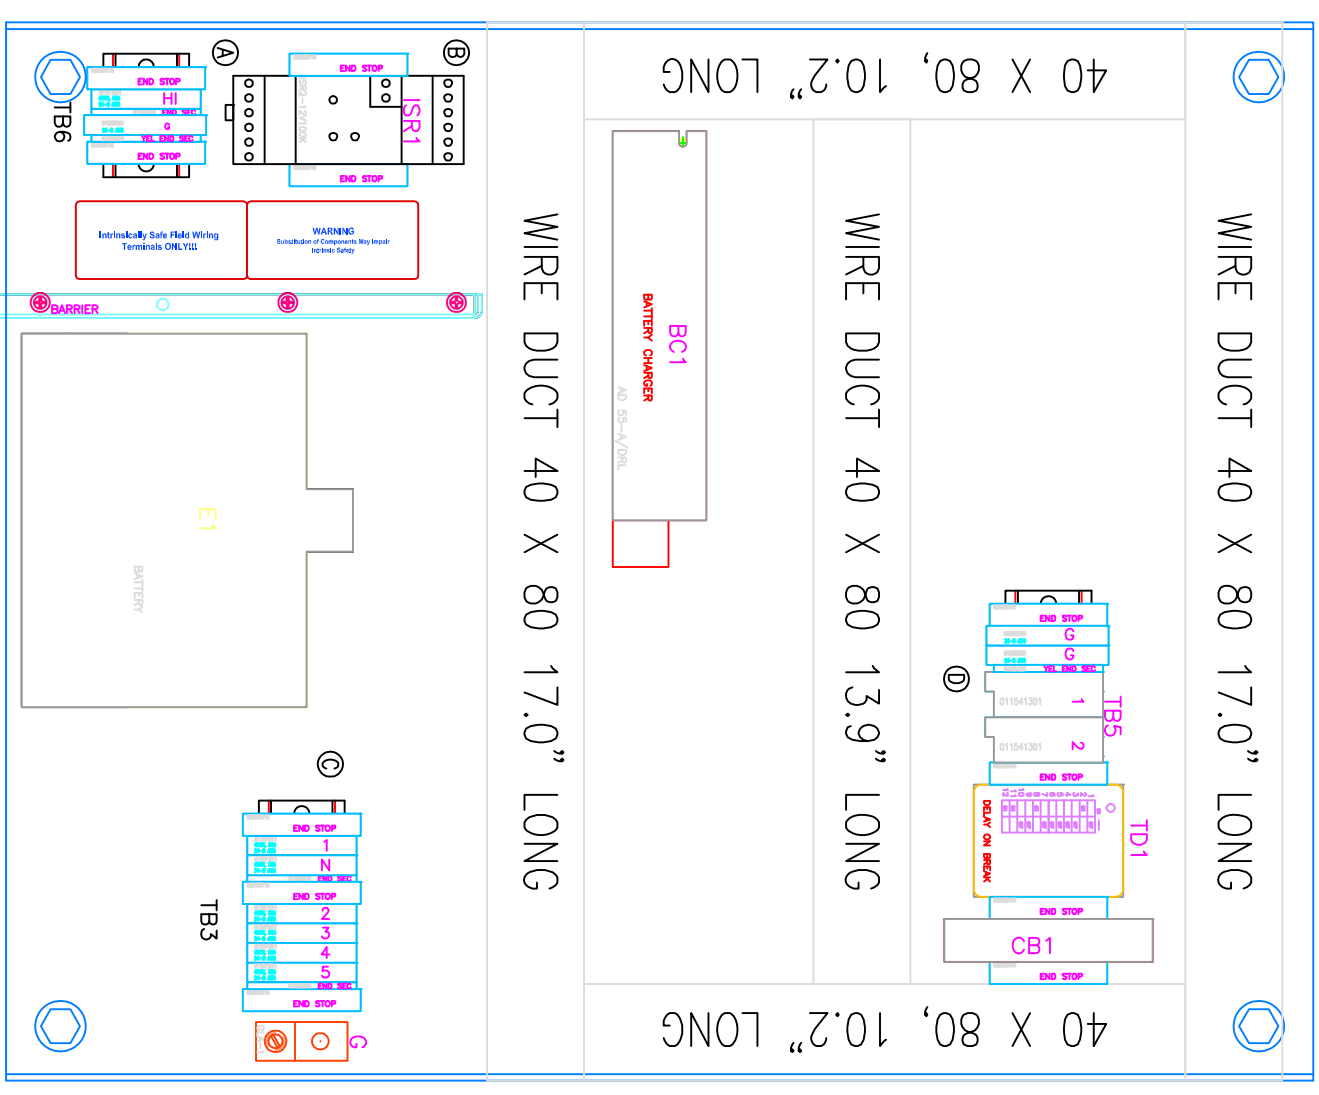

NOTE 1

NOTES 4, 5

ALARM SUB PANEL

- DIN RAIL LENGTHS:
- A. 2.00"
 - B. 2.25"
 - C. 3.50"
 - D. 6.50"

SEWER PANEL 3M

NOTE:
THESE ARE SAMPLE DRAWINGS ONLY.
THE PUMP CONTROL PANEL FABRICATOR SHALL VERIFY RATINGS, DIMENSIONS, AND LISTINGS OF ALL PRODUCTS PRIOR TO DESIGNING PANELBOARD. EQUIPMENT SHOWN HEREIN IS FOR INFORMATION USE ONLY AND IS SHOWN FOR ONE MOTOR SIZE. PUMP OTHER MOTOR SIZES WILL AFFECT COMPONENT RATINGS AND REQUIREMENTS. PUMP CONTROL PANEL FABRICATOR IS RESPONSIBLE FOR ALL EQUIPMENT IN PANEL.

ALARM PANEL

NOT TO SCALE

BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS

REVISED 08/01/08