


NOTE: PIPELINE MARKERS TO BE LOCATED EVERY 1000' ALONG THE WATER LINE & ABOVE FITTINGS WHERE THE ALIGNMENT CHANGES, OR AS DIRECTED BY THE ENGINEER.

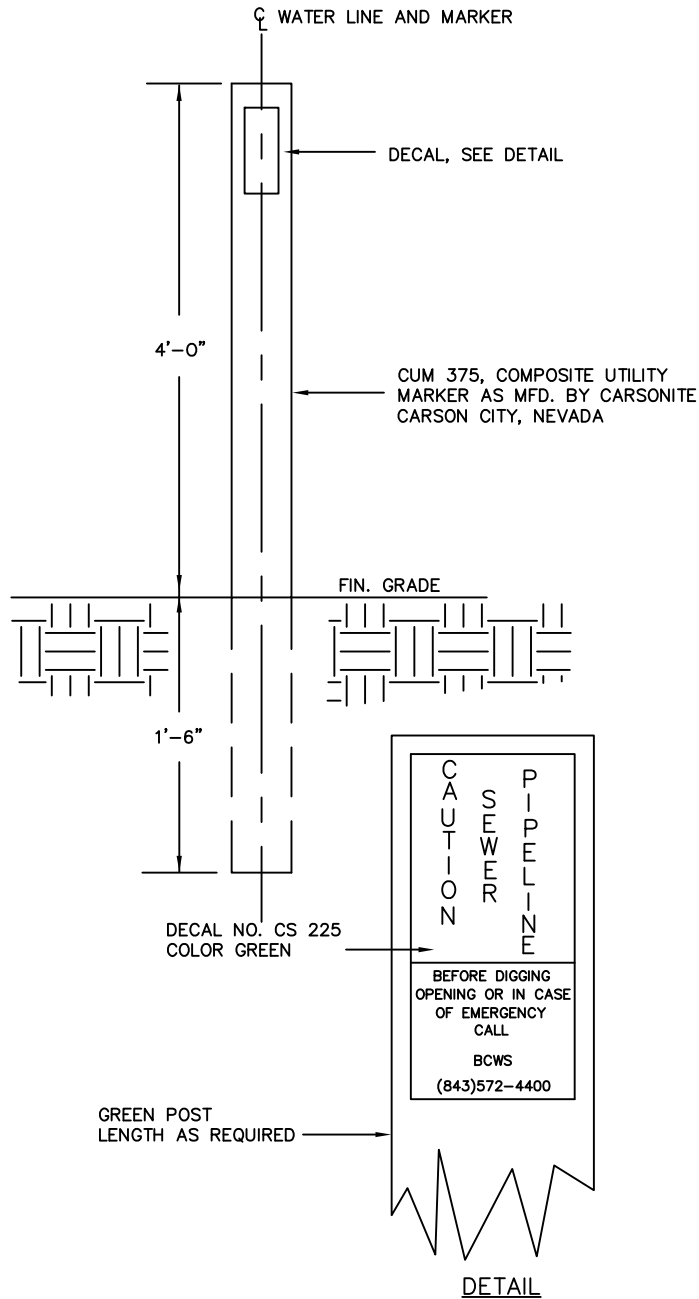

LINE MARKER

NOT TO SCALE

SEWER PANEL 2E

BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS

REVISED 07/21/09