


OPENING DETAIL - PLAN VIEW
N.T.S.

CONCRETE PERSONNEL PAD SHALL HAVE ADEQUATE
SLOPE TO PROVIDE POSITIVE DRAINAGE AWAY FROM
THE WET WELL.

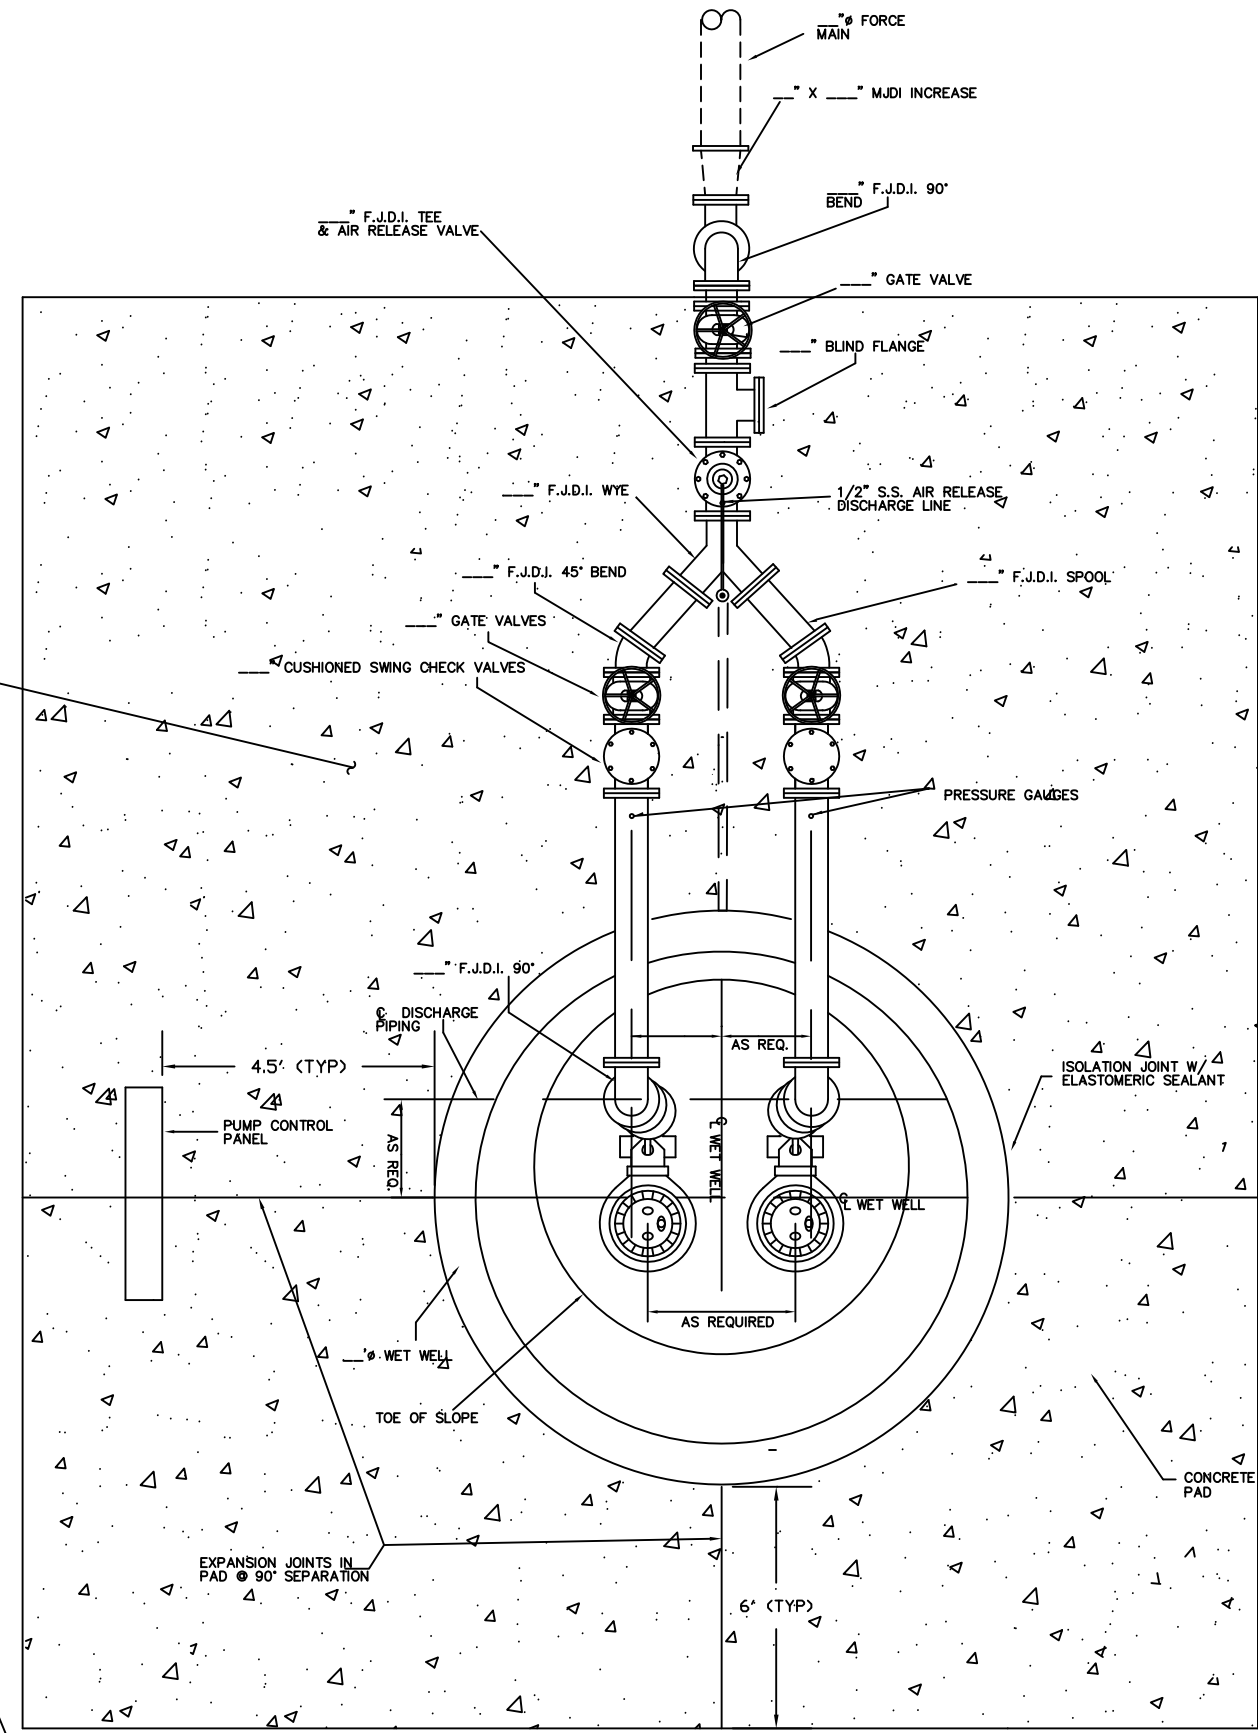

*TYPICAL SMALL PUMP STATION
PLAN VIEW*

NOT TO SCALE

PLAN

SEWER PANEL 3A

BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS

REVISED 06/08/10