


- NOTE:
1. MEGALUG GLANDS SHALL BE USED ON ALL MECHANICAL JOINTS.
 2. SEE APPENDIX F29 FOR BCWS APPROVED HYDRANTS
 3. PAINTED RED TO OPEN LEFT.

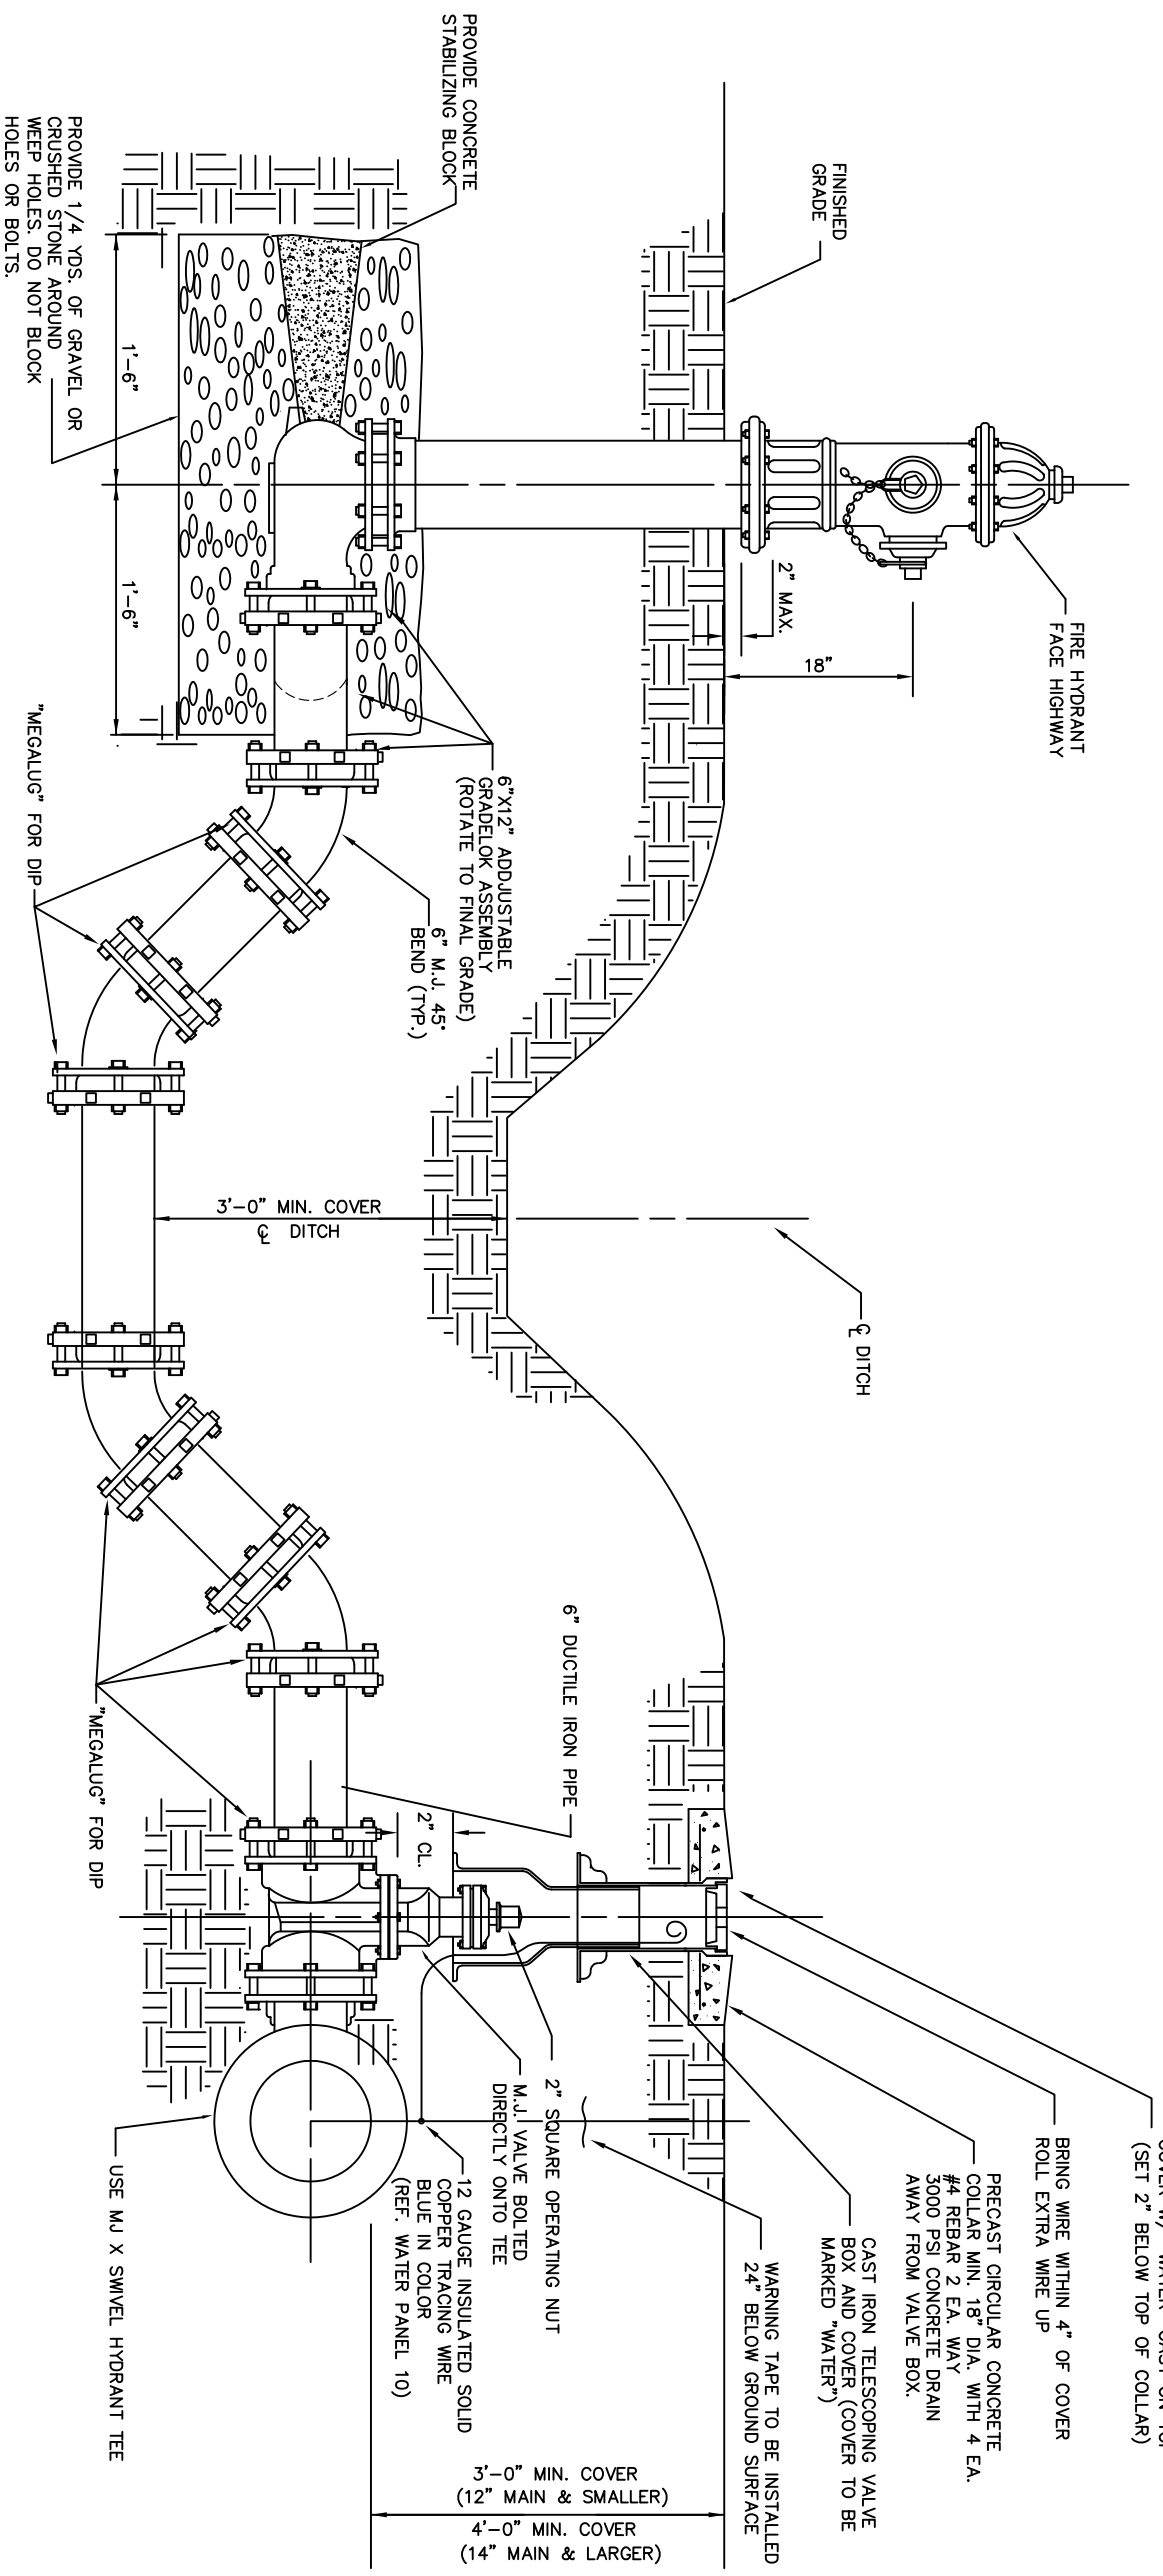

TYPICAL DETAIL

FIRE HYDRANT WITH VALVE AND BOX FOR DRAINAGE CROSSING

NOT TO SCALE

WATER PANEL 4B

BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS

REVISED 04/14/11